

Certification Body:



**BUREAU
VERITAS**

Bureau Veritas Australia Pty Ltd
Level 11/500 Collins Street,
Melbourne VIC, 3000
Ph: 1800 855 190
www.bureauveritas.com.au

Certificate Holder:



Sto Australia Pty Ltd
96 Prosperity Way,
Dandenong VIC 3175
PH: (03) 9768 4900
www.stoaustralia.com.au

Certificate number: CM70007 Rev5

THIS IS TO CERTIFY THAT

Unitex® Australia Non-Cavity Base Board® System

Type and/or use of product:

Unitex® Australia Base Board® Non-Cavity System is an expanded polystyrene external wall cladding system.

Description of product:

Unitex® Australia Base Board® System is an expanded polystyrene (EPS) external wall cladding system. Available in three thicknesses, with M Grade EPS 50mm core, SL or M Grade EPS 75mm core, or SL or M Grade EPS 100mm core.

COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)

BCA 2022 Amdt.2

	Volume One	Volume Two	
Performance Requirement(s)	N/A	H1P1(1), limited to (2)(b)(c)	Structural reliability and resistance
		H2P2	Weatherproofing
		H7P5	Building in Bushfire prone areas
Deemed-to-Satisfy Provision(s):	N/A	N/A	
State or territory variation(s):	N/A	TAS H7P5	



Sam Guindi – Product Certification Manager
Bureau Veritas Australia Pty Ltd



Harley Parkes - Unrestricted Building Certifier
Jensen Hughes Pty Ltd

Date of issue: 9 March 2022

Revalidated: 15 April 2026

Date of expiry: 30 January 2028



Certificate of Conformity

SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B

Limitations and conditions:

1. Unitex® Baseboard Non-Cavity System shall be installed in accordance with the Unitex® Baseboard Non-Cavity Technical Manual, dated August 2024.
2. Unitex® Baseboard Non-Cavity System is suitable for use in bushfire prone areas up to and including BAL29 when installed in conjunction with 9mm render, or up to and including BAL 40 when installed in conjunction with 17.5mm render, as detailed in Unitex® Baseboard Non-Cavity Technical Manual (dated August 2024) and the Warringtonfire Test Report, Ref: 51504300, Rev R2.0 (dated 28 February 2023)
3. The product has not been tested to provide an FRL and shall not be used for Class 1 and Class 10a buildings located within 900mm of an allotment boundary or within 1800mm of another building on the same allotment.
4. When using H2V1 to determine compliance with H2P2, the risk score specific to the project must be calculated in accordance with the requirements of BCA Table V2.2.1.
5. The product shall only be used with breathable sarking behind the panels.
6. Unitex® Baseboard Non-Cavity System shall be installed to framing quick complies with AS1684.2-2021 and AS 1684.4-2010 for timber framing, or AS/NZS 4600-2018 or the NASH Standard for steel framing, as applicable, and all fastenings shall be protection against corrosion as set out in Table 5.6.5d of the ABCB Housing Provisions Standard.
7. The product is permitted to be used in non-cyclonic areas (Wind Regions A & B) up to and including N4. Refer to Unitex® Baseboard Non-Cavity Technical Manual, dated August 2024 for fixing requirements.
8. Unitex® Baseboard Non-Cavity System is not suitable for use in construction associated with heating appliances, fireplaces, chimneys and flues.

Building classification/s:

Volume 2 - Class 1a and 1b buildings

Scope of certification: The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website www.abcb.gov.au. This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

Disclaimer: The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate.

APPENDIX A – PRODUCT TECHNICAL DATA


A1 Type and intended use of product

As Above.

A2 Description of product

The Unitex® Base Board® Non-Cavity System is consists of:

1. Unitex® Breathable Vapour-Permeable Wall Wrap
2. Self-adhesive flashing tape for weatherproofing
3. Unitex® IB-Board Panel or Unitex® Base Board®
4. Unitex® adhesive expanding foam
5. Uni-Screw®/Washer Fixers (Mushrooms)
6. Unitex® aluminium Starter Channel and/or Levelling Base Block (BAL 29 & BAL40)
7. Aluminium Corner Angles, Aluminium pre-meshed Corner Angles and expansion beads
8. Unitex® Polymer Render
9. Uni-Mesh® IM 250 or 1 m AR Fibreglass Mesh
10. Uni-Dry Cote® BBR (Base Board® Render)
11. Uni-Shape® Polycarbonate Sealant
12. Unitex® Applied Texture Finish such as Uni-Trowel Décor®
13. Uni-PTC® exterior surface coating
14. Primers and Sealants
15. Uni-Shape® Sill Blocks

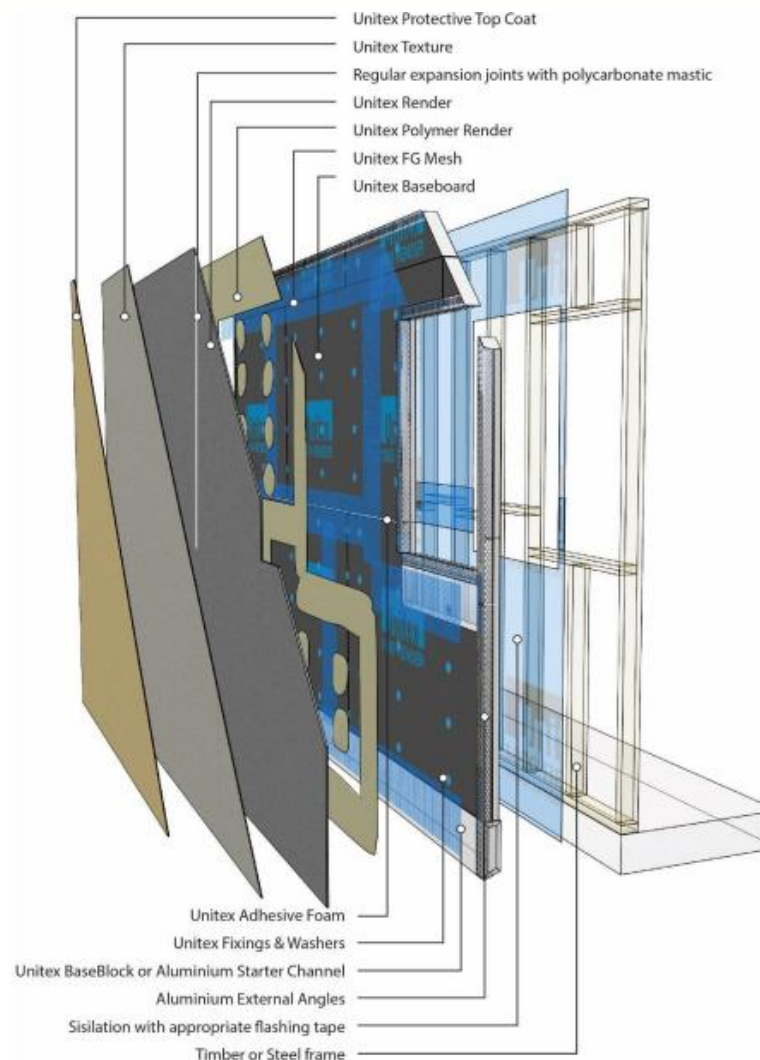

Unitex® Baseboard Non-Cavity Technical Manual, dated August 2024.



Certificate of Conformity

A3 Product specification

Details of specification can be found in Unitex® Base Board® Non-Cavity System Technical Manual, dated August 2024.

A4 Manufacturer and manufacturing plant(s)

Sto Australia Pty Ltd, 96 Prosperity Way, Danandenong South, VIC 3175.

A5 Installation requirements

Unitex® Baseboard Non-Cavity System shall be installed in accordance with the Unitex® Baseboard Non-Cavity Technical Manual, dated August 2024.

A6 Other relevant technical data

N/A

APPENDIX B – EVALUATION STATEMENTS

B1 Evaluation methods

BCA 2022 Amdt.2

1. Structural Assessment

A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited Testing Laboratory (Ian Bennie & Associates NATA Accreditation No. 2371)

2. Waterproofing Assessment

A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited Testing Laboratory (Ian Bennie & Associates NATA Accreditation No. 2371)

3. Bushfire Assessment

A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited Testing Laboratory (Jensen Hughes, formerly Exova Warringtonfire, NATA Accreditation No. 3277)

B2 Reports

1. Ian Bennie & Associates, Test Report No.2018-068-S2, Unitex® Base Board® System – Direct Fixed 600mm Studs with 400mm Fixings Static Ultimate Wind Load Tests to AS4040.2, 23 October 2018.

This report provides the results of testing to the requirements of AS 4040.2 for resistance to wind pressure for non-cyclone regions and confirms that the system passed the strength limit state test requirements of AS 4040.2 method 2: Resistance to wind pressure for non-cyclone regions up to the strength limit state pressure of 3.42 kPa.

2. Ian Bennie & Associates Test Report No.2018-068-S3, Unitex® Base Board® System – Direct Fixed 600mm Studs with 400mm Fixings Impact Tests to AS4040.5, 23 October 2018.

This report provides the results of testing to the requirements of AS/NZS 4040.5 for resistance to impact (Sandbag) for wall boards and determined that under the test parameters the product did not indent, however showed signs of minor cracking.

3. Ian Bennie & Associates Test Report No.2018-068-S1 Unitex® Base Board® System – Direct Fixed Specimen Tests to NCC-2016 Verification Methods FV1 and V2.2.1, 13 September 2018.

This report is a performance-based solution via a verification method provides the results of testing to the requirements of AS/NZS 4284:2008 and confirms that the product passed all testing requirements of FV1 and V2.2.1 of NCC 2016, being the same requirement in NCC 2022.

4. Warringtonfire, Fire Assessment Report, The Bushfire resistance performance of a Unitex® framed wall system with rendered EPS panels in accordance with AS 1530.8.1:2007, Report No: 51504300, Rev R2.0, dated 28 February 2023.

This report provides the assessment of the results to testing (undertaken by Exova Warringtonfire 2013) to AS1530.8.1 and confirms the result that the product may be used in areas up to BAL29 when installed with 9mm render, and up to BAL 40 when installed with 17.5mm render, in accordance with the installation manual.